

IKI-50_2F R2e

Universal Fault Indicator for intelligent distribution network stations

The universal fault indicator **IKI-50 R2e** is the appropriate solution for intelligent distribution substations and offers distribution system operators a high level of transparency and cost-effectiveness. The **IKI-50 R2e** includes all algorithms for selective fault detection. It is suitable for all neutral point treatments. Information on faults, load curves or limit violations is thus available on site as well as in the central network control center. Faults can be detected and localized immediately. The **IKI-50_2F R2e** monitors two feeders.



Properties

Fault detection

- Directional short-circuit detection
- Directional ground short-circuit detection, directional static ground fault detection (wattmetric method), directional transient ground fault detection (wiper method), earth fault detection via pulse locating
- Suitable for all neutral point treatments
- No summing transformer required

Fault early detection

- Fault early detection by detection of transient disturbances
- Partial discharge trend detection together with CAPDIS-S2_55 (R5)

Load flow measurement

- Voltages, Currents, powers, frequencies, cos-phi, . . ."
- Momentary and average values
- Limit monitoring

Network automation

- Extensive logic functions freely programmable with PC software KriesConfig

IKI-50 R2e is maintenance-free

- No battery
- Unlimited data retention
- Fault indication in case of power failure over 6 hours



Kries Energietechnik GmbH & Co. KG

Sandwiesenstr. 19 | D-71334 Waiblingen

kries.com | sales.kries@te.com | (+)49-7151-7074-860

22.08.24

Page 1/8

IKI-50_2F R2e

Universal Fault Indicator for intelligent distribution network stations

Technical Data

Device data

Article number	2502485
Product designation	IKI-50_2F R2e Universal fault indicator for intelligent distribution substations 2 feeder version
Number of feeders	2
Parameterization software	KriesConfig
Configuration	Via software Kries-Config (download at kries.com), Via HMI and display (limited)

Operating elements and display

Front display	LC-Display and LEDs
Direction keys	Operation via four direction keys
Red LED (1)	Error event detected internal energy storage empty
Yellow LED (2)	Slave test Primary test Device warnings
Dreen LED (3)	Status message device status
Two feeder monitoring	✓
Buffer of power supply	Capacitor (6h)

Dimensions and installation instructions

Case height x width x depth	49 x 96 x 108 mm
Cutout height x width	45 x 92 mm
Norm cutout dimensions	DIN IEC 61554:2002-08
Installation type	Panel mounting
Sheet thickness	1.5 ... 2.5 mm

Operating conditions

Operating temperature	-25°C ... 55°C
Storage temperature	-25°C ... 70°C
Humidity	max. 95 % relative Feuchte bei 40° C
Protection class	IP54 (Front)

Fault detection and failure forecast

Fault detection	Individually selectable, any combinations possible
Star point types	Short-term low-ohmic terminated neutral, Low-ohmic terminated neutral, Inductive terminated neutral, Isolated neutral



Kries Energietechnik GmbH & Co. KG

Sandwiesenstr. 19 | D-71334 Waiblingen

kries.com | sales.kries@te.com | (+)49-7151-7074-860

22.08.24

Page 2/8

IKI-50_2F R2e

Universal Fault Indicator for intelligent distribution network stations

Fault detection and failure forecast

Short circuit detection I>>	✓
Directional short-circuit detection I>>	✓
Threshold current short-circuit detection I>>	100 A ... 1,000 A (adjustable in steps)
Threshold time short-circuit detection I>>	40 ms ... 1,600 ms (adjustable in steps)
Earth short-circuit detection Ie>>	✓
Directional earth short-circuit detection Ie>>	✓
Threshold current earth short-circuit detection Ie>>	40 A ... 1,000 A (adjustable in steps)
Threshold time earth short-circuit detection Ie>>	40 ms ... 1,600 ms (adjustable in steps)
Directional static earth fault detection Ie>;	✓
Threshold current static earth fault detection Ie>	2 A ... 30 A (adjustable in steps)
Directional transient earth fault detection Ie>	✓
Threshold current transient earth fault detection 3IO	1 A ... 1,000 A (freely adjustable)
Threshold voltage transient earth fault detection 3U0	1 kV ... 300 kV (freely adjustable)
Earth fault detection via pulse locating	✓
Pulse length of pulse locating	symmetrical / asymmetrical
Transient fault detection IIe>	✓
TE trend monitoring	<ul style="list-style-type: none">• in connection with CAPDIS-S2_55 (R5)• Indication on display, transmission via Modbus-RTU• Partial discharge trend via frequency distribution; integration over 24h, trend over 72h
Fault reset	Auto, Manually on the device, After time (1 h ... 8 h, configurable)
Event log	The last 20 fault events are stored with event number, date, time, name of the triggering fault detection, fault direction, phase and fault current value.
Earth fault transient detection	✓
Directional earth short-circuit detection	✓

Interfaces and communication

USB interface	Mini-USB
Modbus-RTU	✓
Modbus-RTU Slave	✓
Modbus transmission rates [kBd]	9600, 19200, 38400, 57600, 115200
Slave test	✓
Digital Inputs	4
Potential-free digital inputs	4
Digital Outputs	4
Digital IOs configurable	Yes



Kries Energietechnik GmbH & Co. KG

Sandwiesenstr. 19 | D-71334 Waiblingen

kries.com | sales.kries@te.com | (+)49-7151-7074-860

22.08.24

Page 3/8

IKI-50_2F R2e

Universal Fault Indicator for intelligent distribution network stations

Interfaces and communication

Switching functions feeder control unit	--
Connection cable cross section	Max. 2,5 mm
Switching capacity relay	AC: max. 62,5 VA max. 2A; max. 250 VAC DC: max. 2A @ 40 VDC
Relay outputs	4
Voltage inputs	2 (LRM/CAPDIS)
Current transformer	6

Measurement values and functions

Voltage measurement	✓
Measuring range voltage	Capacitive
Phase-to-ground voltages	✓
Phase to phase voltages	✓
Measuring range voltage	0.02 kV ... 92 kV Start of voltage measuring range: 2% of Un
Precision voltage measurement	--
Cross calibration	-
Current measurement	✓
Measuring range current	0.5 A ... 1,158 A (with current transformer IKI-LUM)
Zero-sequence current	✓
Conductor currents	✓
Active power	✓
Reactive power	✓
Apparent power	✓
Rotary field detection	✓
Frequency measurement	✓
Mean value determination	✓
Min-max value determination	✓
Phase position	✓
Phase shift cos-phi	✓
Limit value monitoring	Voltage, current, frequency, reactive power and voltage
Logic functions programmable	A total of 32 logic rules can be programmed.

Power supply

Auxiliary power supply	24...230 VAC/DC (jeweils 15 %)
Power consumption	2 W



Kries Energietechnik GmbH & Co. KG

Sandwiesenstr. 19 | D-71334 Waiblingen

kries.com | sales.kries@te.com | (+)49-7151-7074-860

22.08.24

Page 4/8

IKI-50_2F R2e

Universal Fault Indicator for intelligent distribution network stations

Power supply

Insulation voltage	2 kV, 1 min
CT-supplied	-
Capacitor buffer	✓
Display buffer for fault indication	Unlimited data retention (independent of auxiliary power and buffer power); Error display after power failure (depending on adjustable follow-up time): <ul style="list-style-type: none">• with overrun time 12 seconds: 6 hours• with run-on time 60 seconds: 4.5 hours

Compatible current transformers

Article number	Product designation
2512106_H001	IKI-LUM_d92 Split-Core Transducer with cable tie (set) Ø 92mm
2512106_H003	IKI-LUM_d92 Split-Core Transducer for C-Cone-Bushings (set) Ø 92mm
2512106_H004	IKI-LUM_d92 Split-Core Transducer for SIEMENS-Bushings (set) Ø 92mm

Connecting cables CTs

Article number	Product designation
3503118_S	Connecting cable set pluggable Length = 3,0m
3503135_S	Connecting cable set pluggable Length = 5,0m
3503135_S999	Connecting cable set pluggable Lengths on request

Accessories

Article number	Product designation
2500484	Y-cable IKI to CAPDIS 0.4 m 2 x system plug
2500486_H002	Y-Cable IKI to CAPDIS 0.4 m Sx blade plug to system plug, decoupled
2500487	Y-cable IKI to CAPDIS 0.4 m 2 x Sx blade plug to system plug
2500484_S999	Y-cable CAPDIS to IKI; Lengths and connector combinations on request



Kries Energietechnik GmbH & Co. KG

Sandwiesenstr. 19 | D-71334 Waiblingen

kries.com | sales.kries@te.com | (+)49-7151-7074-860

22.08.24

Page 5/8

Comparison of products

	IKI-50_2F R2e 2502485	IKI-50_1F R2 2502352
Level of digitalisation	1	2
Short circuit detection I>>	✓	✓
Directional short-circuit detection I>>	✓	✓
Earth short-circuit detection Ie>>	✓	✓
Directional earth short-circuit detection Ie>>	✓	✓
Earth fault transient detection	✓	✓
Pulsation detection	✓	✓
Directional static earth fault detection Ie>;	✓	✓
Slave test	✓	✓
Relay outputs	4	6
Modbus-RTU	✓	✓
Modbus-RTU Slave	✓	✓
CT-supplied	-	-
Auxiliary power supply	24...230 VAC/DC (jeweils 15 %)	24...230 VAC/DC (jeweils 15 %)
Buffer of power supply	Capacitor (6h)	Capacitor (6h)
USB interface	Mini-USB	Mini-USB
Digital Inputs	4	6
Digital Outputs	4	4
Digital IOs configurable	Yes	Yes
Switching functions feeder control unit	--	Switching of up to two load switches 1.5-pole switching
Digital outputs for 1.5 pole switching		2
Voltage inputs	2 (LRM/CAPDIS)	2 (1x LRM/CAPDIS, 1x precision 3.25V)
Voltage measurement	✓	✓
Precision voltage measurement	--	Yes
Measuring range voltage	Capacitive	Capacitive (Input F1), Precision divider with an output signal of 3.25 V/sqrt(3) in nominal operation (input UF2)
Cross calibration	-	✓
Current measurement	✓	✓
Logic functions programmable	A total of 32 logic rules can be programmed.	A total of 32 logic rules can be programmed.
Balanced core CT optional	-	-

IKI-50_2F R2e

Universal Fault Indicator for intelligent distribution network stations

	IKI-50_2F R2e 2502485	IKI-50_1F R2 2502352
Compatible CTs	IKI-LUM_d92 Split-Core Transducer with cable tie (set) Ø 92mm (2512106_H001) IKI-LUM_d92 Split-Core Transducer for C-Cone-Bushings (set) Ø 92mm (2512106_H003) IKI-LUM_d92 Split-Core Transducer for SIE-MENS-Bushings (set) Ø 92mm (2512106_H004)	IKI-LUM_d92 Split-Core Transducer with cable tie (set) Ø 92mm (2512106_H001) IKI-LUM_d92 Split-Core Transducer for C-Cone-Bushings (set) Ø 92mm (2512106_H003) IKI-LUM_d92 Split-Core Transducer for SIE-MENS-Bushings (set) Ø 92mm (2512106_H004)



Kries Energietechnik GmbH & Co. KG

Sandwiesenstr. 19 | D-71334 Waiblingen

kries.com | sales.kries@te.com | (+)49-7151-7074-860


22.08.24

Page 7/8

IKI-50_2F R2e

Universal Fault Indicator for intelligent distribution network stations

Wiring diagram

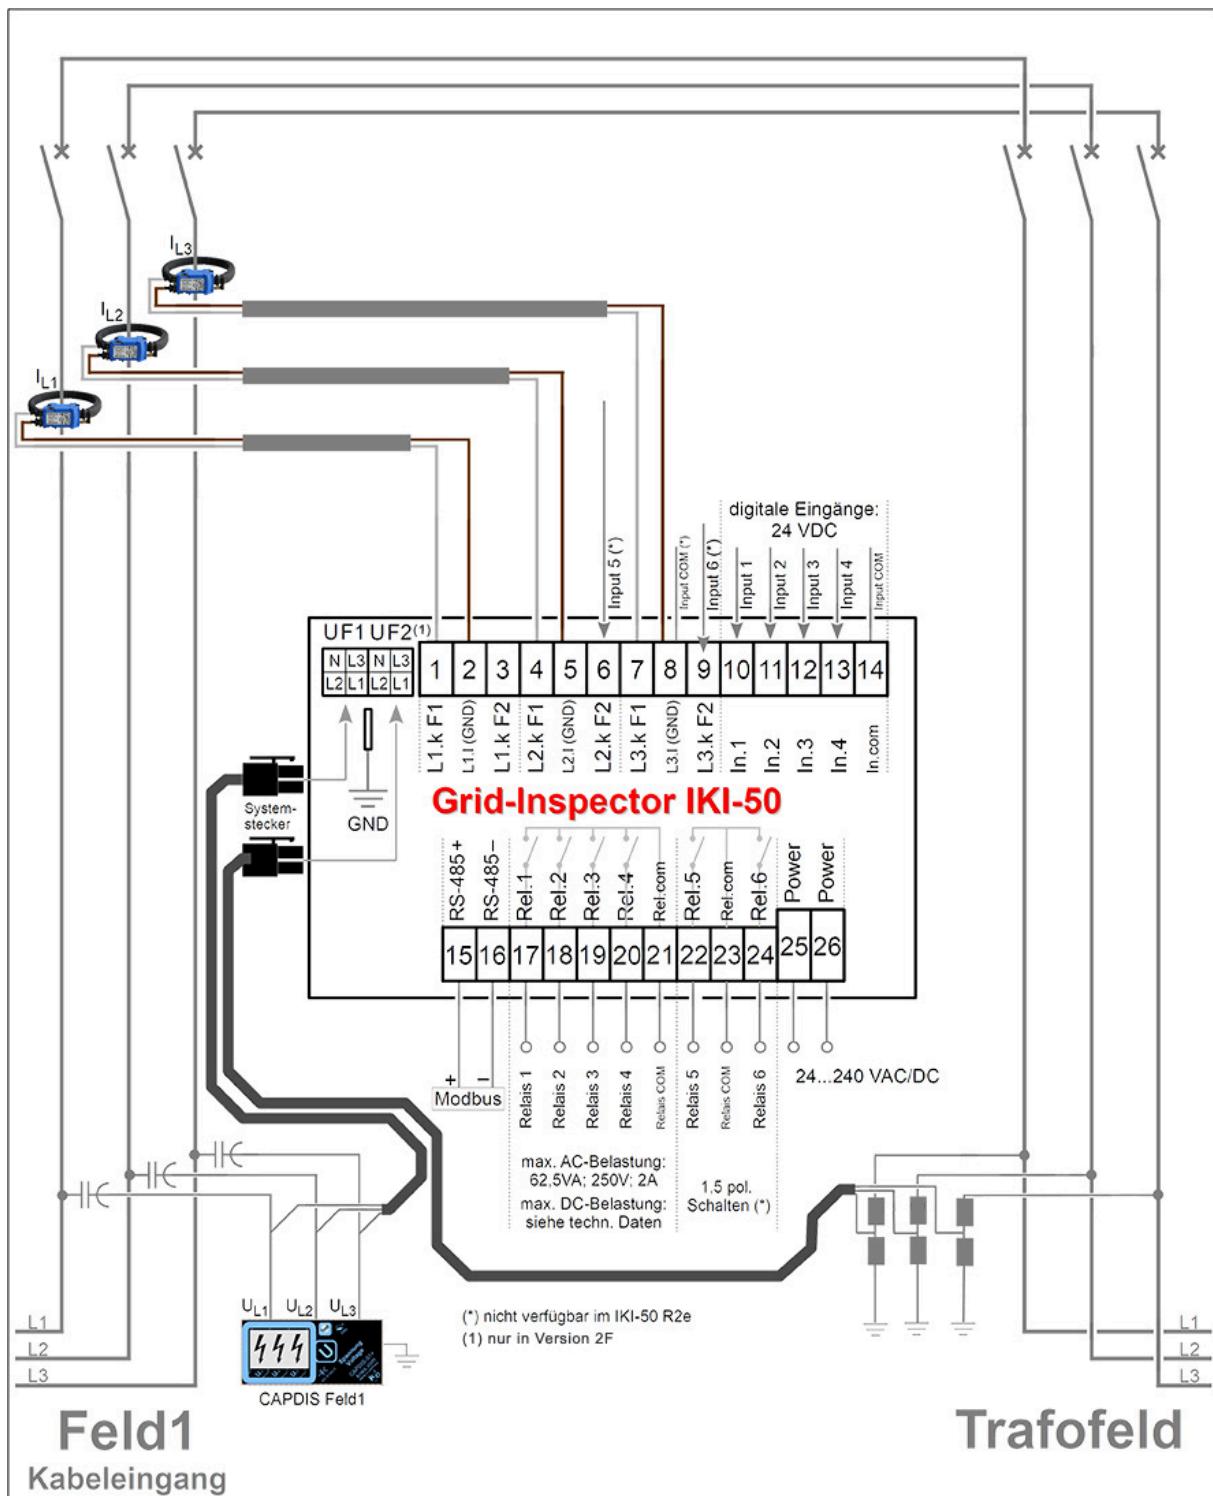

Kries Energietechnik GmbH & Co. KG

Sandwiesenstr. 19 | D-71334 Waiblingen

kries.com | sales.kries@te.com | (+)49-7151-7074-860

22.08.24

Page 8/8